


Gas Cylinder Storage



All cylinders (full or empty) are secured by a chain or other similar means to prevent them from being knocked over.

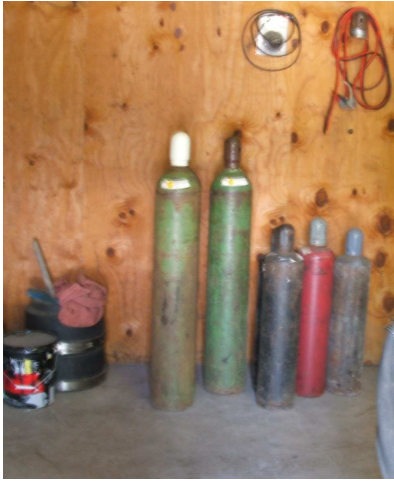

Flammable gases and oxidizers are stored a minimum of 25-feet apart or separated by 1/2-hour fire rated wall.



Valve protectors or caps are in place when cylinder (full or empty) is not in use or storage.